
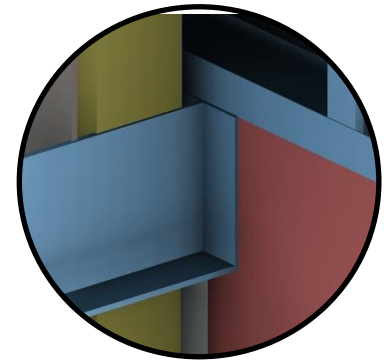


Detail 2.4.2

Conventional Curtain Wall with Insulated Spandrel Panel & 5 5/8" x 1 5/8" Steel Stud (16" o.c.) - Beam Intersection Connected to Steel Beam

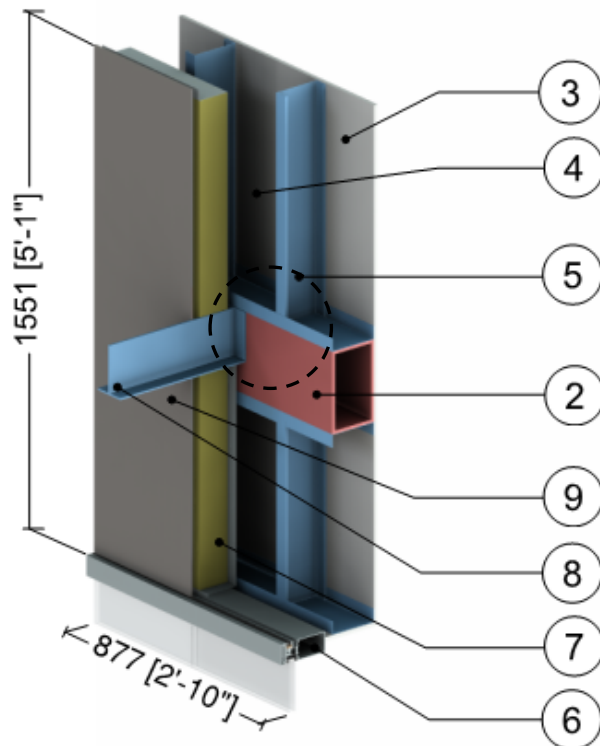

Beam Intersection Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Structural Steel Beam (10" x 6" x 3/8" HSS)	-	347 (50)	-	489 (7830)	0.12 (500)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	5 5/8" (168)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	5 5/8" x 1 5/8" Steel Studs (16" o.c.) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Curtain wall system: minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
7	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.5 RSI to 3.0 RSI)	4 (64)	0.20 (850)
8	Steel Beam (W6x12)	-	347 (50)	-	489 (7830)	0.12 (500)
9	Composite Metal Panel	3/16" (4)	347 (50)	-	489 (7830)	0.12 (500)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2