


## Detail 5.1.79

**Exterior and Interior Insulated 6" x 1 5/8" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Steel Brick Anchors Supporting Brick Veneer and R-20 Batt Insulation in Stud Cavity – Clear Wall**

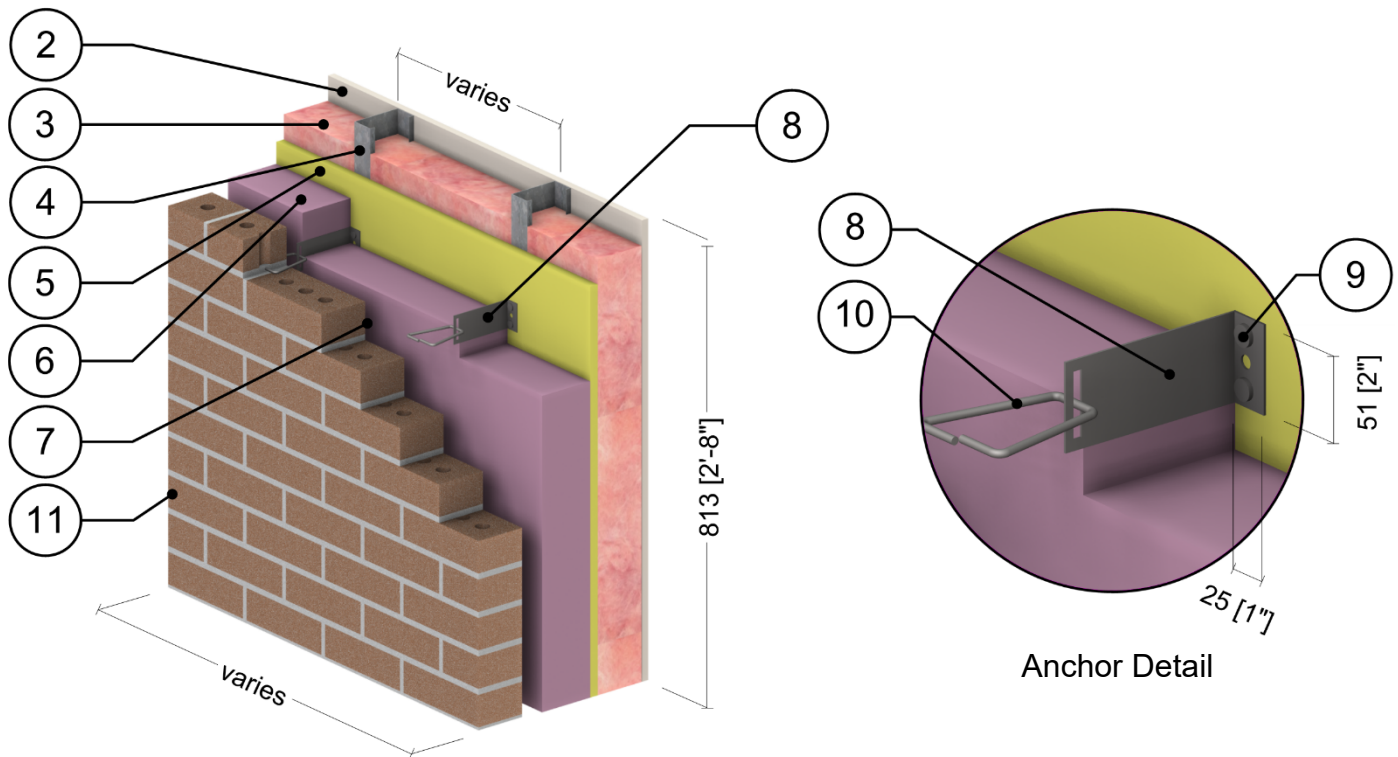

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft <sup>2</sup> -hr-°F (W/m K)	Nominal Resistance hr-ft <sup>2</sup> -°F/Btu (m <sup>2</sup> K/W)	Density lb/ft <sup>3</sup> (kg/m <sup>3</sup> )	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films <sup>1</sup>	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	6" (152)	0.30 (0.043)	R-20 (3.5 RSI)	0.55 (8.8)	0.17 (710)
4	6" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Rigid Insulation	Varies	0.20 (0.029)	R-20 to R-35 (3.52 to 6.16 RSI)	Varies	0.29 (1220)
7	Vented Air Cavity	1 1/2" (38)	-	R-0.4 (0.07 RSI)	0.075 (1.2)	0.24 (1000)
8	Galvanized Steel Veneer Anchor	Varies	430 (62)	-	489 (7830)	0.12 (500)
9	Galvanized Steel Fasteners	0.28" (7) Ø	430 (62)	-	489 (7830)	0.12 (500)
10	Galvanized Steel Wire Pintle	-	430 (62)	-	489 (7830)	0.12 (500)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
12	Exterior Film <sup>1</sup>	-	-	R-0.2 (0.03 RSI)	-	-

<sup>1</sup> Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation