


Detail 8.2.4

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board and R-19 Batt Insulation in Stud Cavity – Independently Supported Balcony Intersection

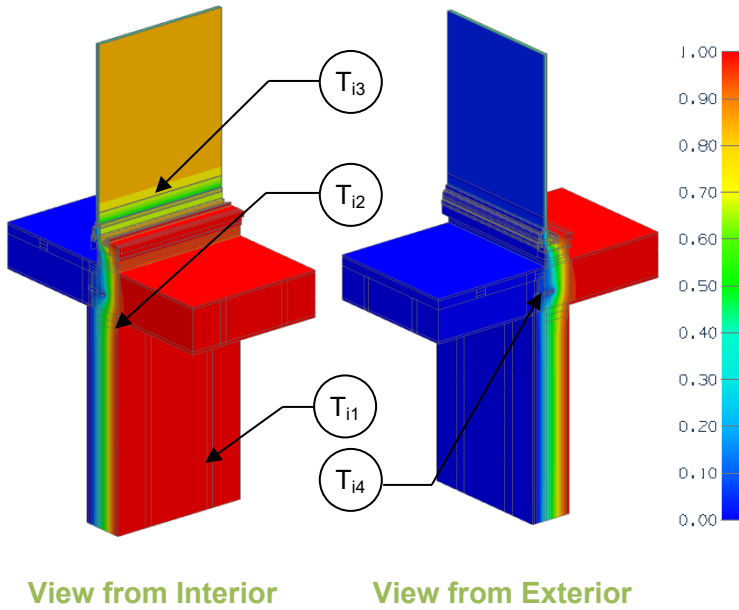

Thermal Performance Indicators

Assembly 1D (Nominal) R-Value	R_{1D}	R-21.6 (3.80 RSI) + exterior insulation
Transmittance / Resistance without Anomaly	U_w, R_w, U_g	“clear wall” U- and R-value w = wood framed wall without balcony g = glazed sliding door
Transmittance / Resistance	U, R	U and R-values for the overall assembly
Surface Temperature Index ¹	T_i	0 = exterior temperature 1 = interior temperature
Linear Transmittance	ψ	Incremental increase in transmittance per linear length of balcony

¹Assumptions and limitations for surface temperatures identified in ASHRAE 1365-RP

Nominal (1D) vs. Assembly Performance Indicators

Base Assembly – Wall

Exterior Insulation 1D R-Value (RSI)	R_{1D} ft ² ·hr·°F / Btu (m ² K / W)	R_w ft ² ·hr·°F / Btu (m ² K / W)	U_w Btu/ft ² ·hr ·°F (W/m ² K)
R-10 (1.76)	R-31.6 (5.56)	R-29.2 (5.14)	0.034 (0.19)
R-15 (2.64)	R-36.6 (6.44)	R-33.7 (5.93)	0.030 (0.17)

Base Assembly – Sliding Door

$U_{\text{centre of glass}}$ Btu/ft ² ·hr ·°F (W/m ² K)	U_g Btu/ft ² ·hr ·°F (W/m ² K)
0.321 (1.82)	0.323 (1.83)

Balcony Transition Linear Transmittance

Exterior Insulation 1D R-Value (RSI)	R ft ² ·hr·°F / Btu (m ² K / W)	U Btu/ft ² ·hr ·°F (W/m ² K)	ψ Btu/ft ·hr·°F (W/m K)
R-10 (1.76)	R-5.9 (1.04)	0.169 (0.96)	0.083 (0.143)
R-15 (2.64)	R-6.0 (1.06)	0.166 (0.94)	0.078 (0.134)

Temperature Indices

	R10	R15	
T_{i1}	0.37	0.43	Min T on sheathing, at fasteners along studs
T_{i2}	0.43	0.51	Max T on sheathing, at studs below floor header beam
T_{i3}	0.49	0.49	Min T on frame, at edge of glass
T_{i4}	0.22	0.22	Min T at balcony bolts, between floor joists